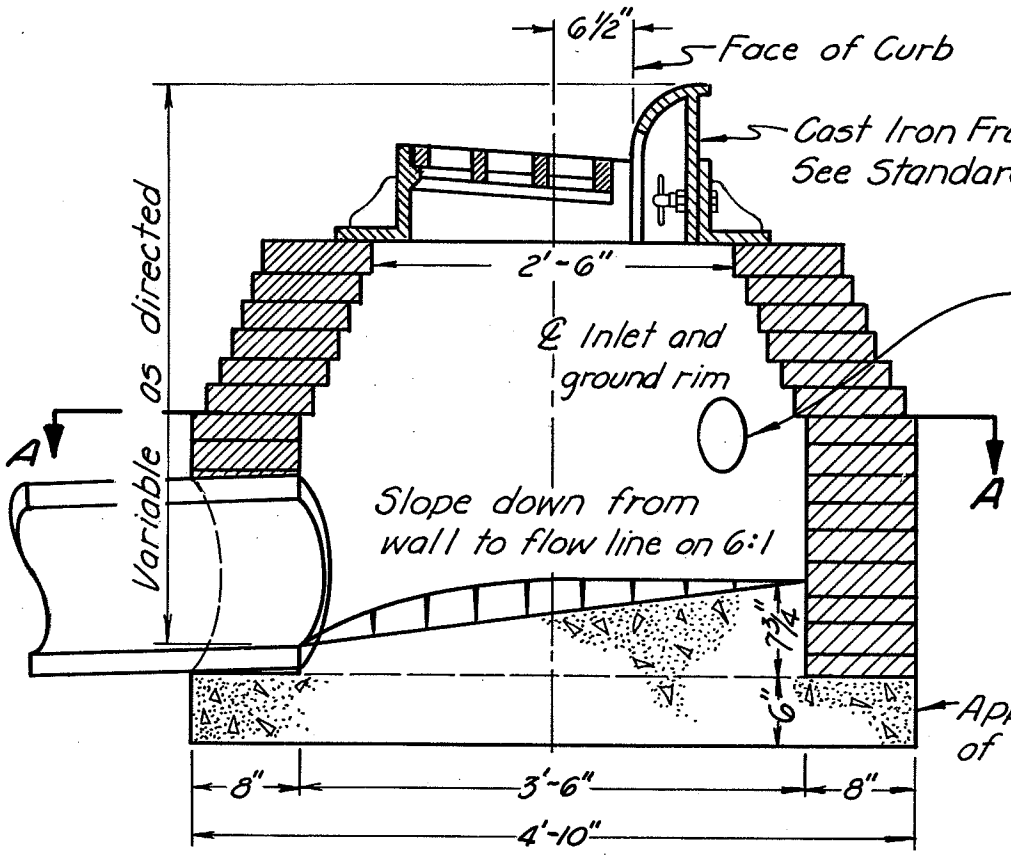

SECTION B-B

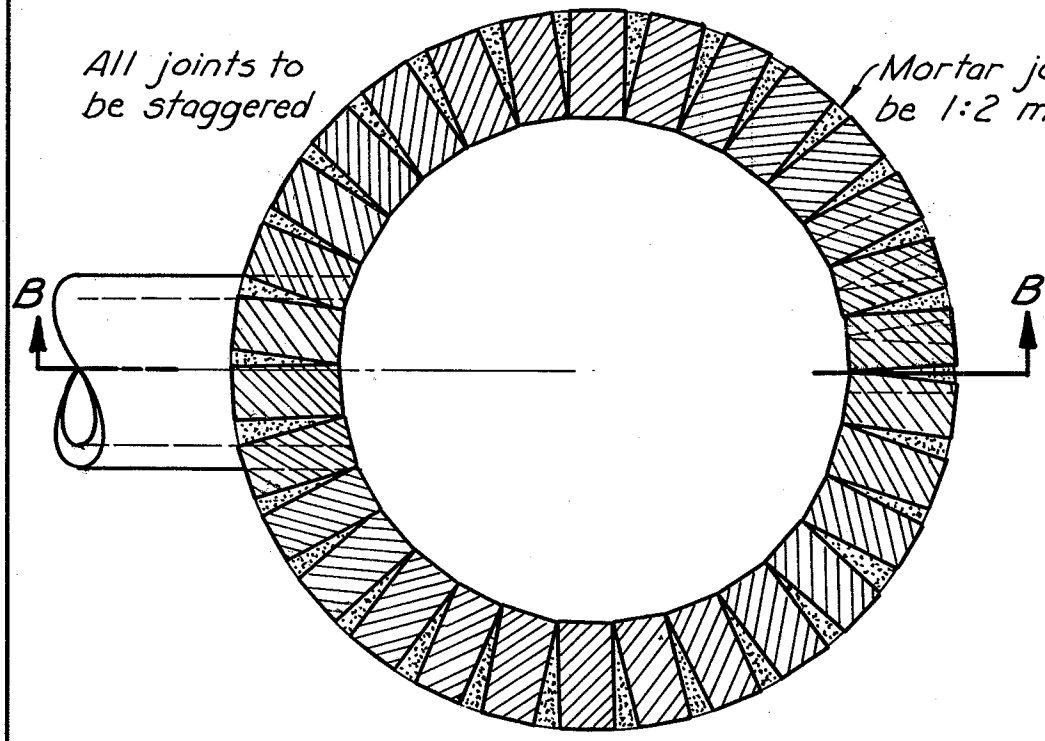

NOTE: Radius Gutter Inlet shall be placed at sump locations only and set so that the grate flowline is 2 inches below the normal gutter elev. Slope gutter to Inlet within 4-feet of grate.

SECTION A-A

Approved 22 Aug 75 Date City Engineer	RADIUS GUTTER INLET	City of Grove City Ohio Standard Construction Drawing Rev. C-GC-5